



FACP Fire Alarm Control Panel

Smoke detector

(S) Smoke detector/alarm

(HD) Heat detector

 Alarm sounder

EMG Emergency lighting in accordance with BS5266

 Fire blanket 1m x 1m unless
otherwise stated

 6 litre fire foam extinguisher

 10kg dry powder fire extinguisher

☐ Total extent of licensed premises

FDKL Fire door keep locked

FDKC Fire door keep closed

 Illuminated Fire Exit sign

Ⓒ Break glass call point for fire alarm in accordance with BS5839

FD30 Fire door to provide min. 30 minutes fire protection


FD30S	Fire door to provide min. 30 minutes fire protection and where restricted smoke leakage at ambient temperatures is needed.
-------	--

Area for consumption of intoxicating liquor

Area for storage of liquor/bar counter

Toilet accommodation

Kitchen & staff areas

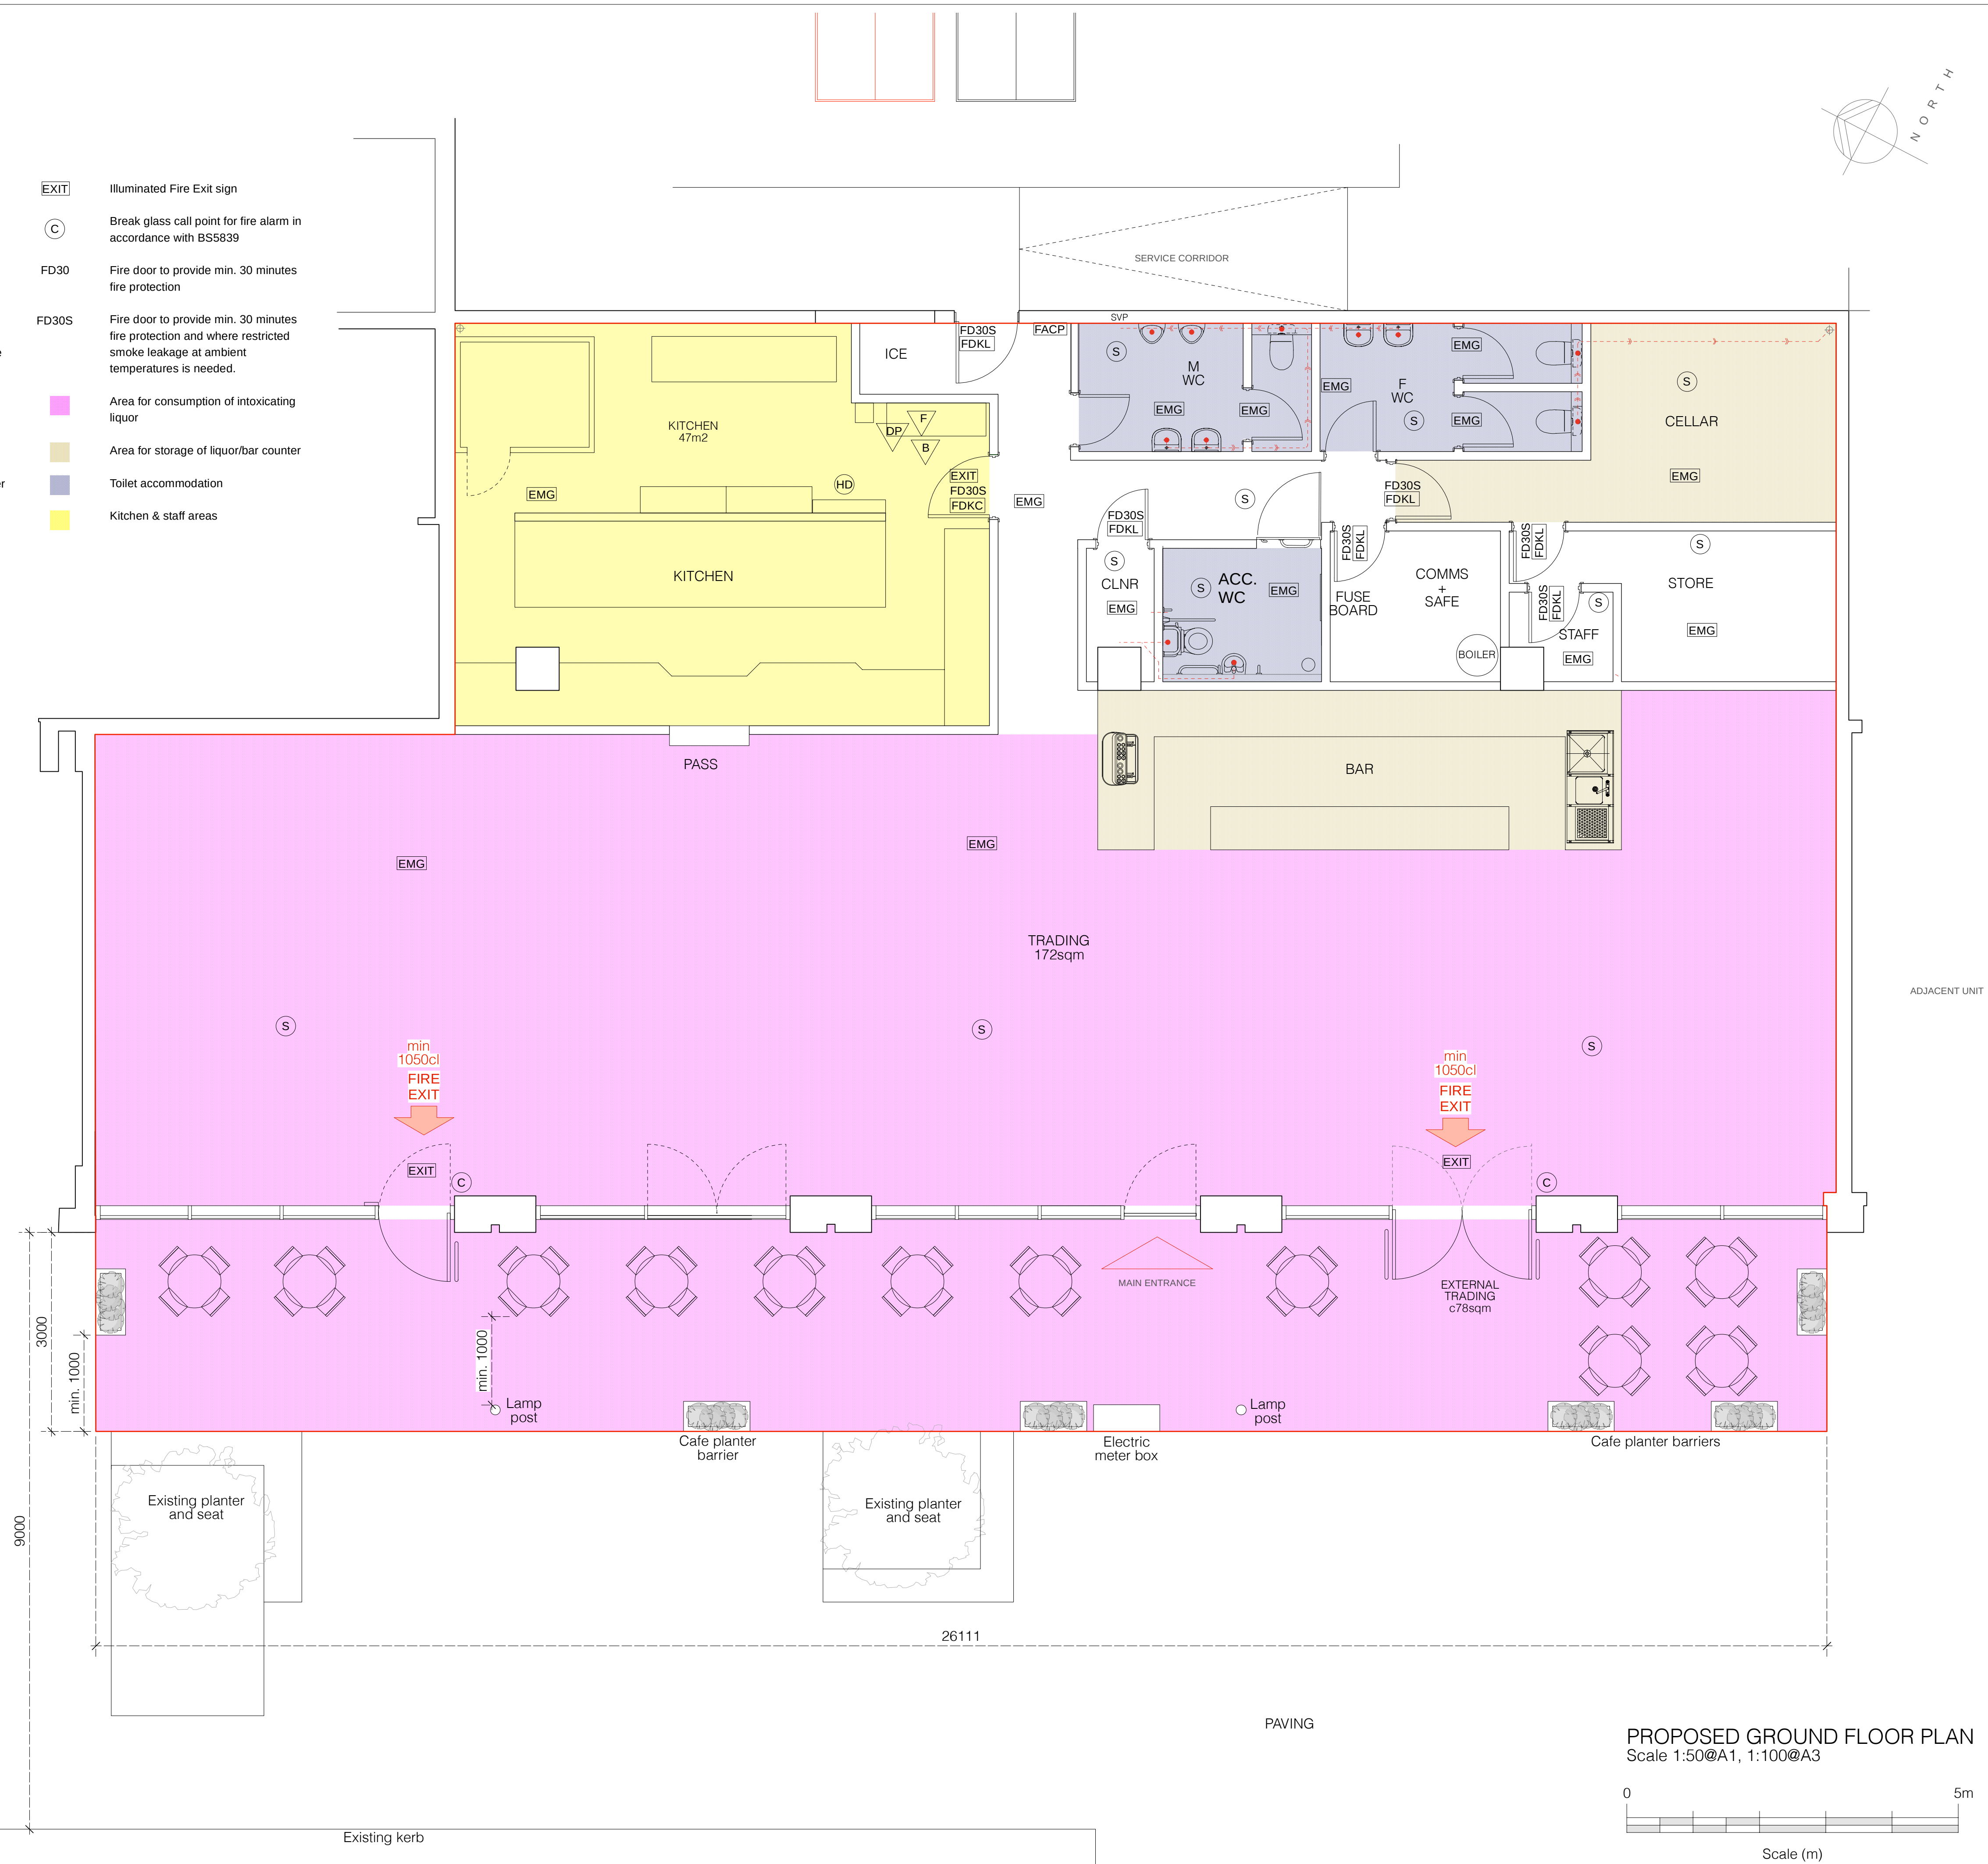

A	06-09-24	FW	CL amends
Rev	Date	Initials	Details

Rev	Date	Initials	Details
-----	------	----------	---------

Purpose of Issue

APPLICATION FOR PREMISES LICENSING

APPLICATION FOR PREMISES LICENSING

RICHARD PEDLAR ARCHITECTS
ARCHITECTURE • CONSERVATION • URBAN DESIGN

ARCHITECTURE • CONSERVATION • URBAN DESIGN

RPCA St Brandon's House 29 Great George Street
Bristol BS1 5QT • 0117 974 2612
www.rpca.co.uk • info@rpca.co.uk

Bristol BS1 5QT • 0117 974 2612
www.rpca.co.uk • info@rpca.co.uk

Bristol BS1 5QT • 0117 974 2612
www.rpca.co.uk • info@rpca.co.uk

Project **LIBERTO LOUNGE** at Unit CO.R1
Egham Surrey

Egham Surrey

Client **Loungers PLC**

Title	Premises Licensing
-------	--------------------

Drawing No. LNG4896.01A

Scale	1:50 @A1 1:100 @ A3	Date	AUG 2024
-------	------------------------	------	----------

Scale 1:50 @ A1 Date AUG 2024
1:100 @ A3

Responsibility is not accepted for errors made by others in scaling from this drawing. All construction information to be taken from figured dimensions only.

Responsibility is not accepted for errors made by others in scaling from this drawing. All construction information to be taken from figured dimensions only.